


Annexure – 2: Picture of Bhartiapal Village and Single Line Diagram



SLD of VE Hamlet Bhastigpal (CS Prastel) Electrical section Bhapur, DED, Dhenkanal, TPODL

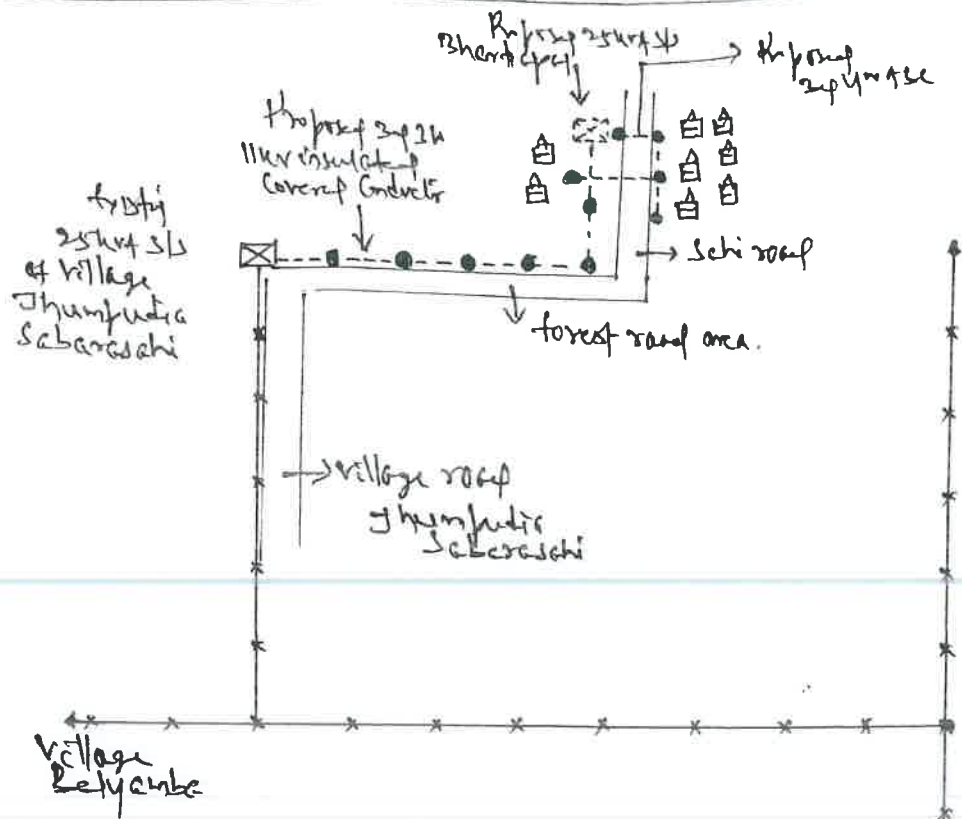

Scope of work:-

- 1- 3-phase 11kV wire insulated Covered Conductor - 2.0km
- 2- 25kVA. Df mounted - 1no
S/S
- 3- 3-phase 25kVA wire - 0.12km,
(3x25 + 1x25mm)

11kV
Bhapur
feeder

5.0MVA
PSS
Bhapur